



EXHAUST PIPE DIAMETER
HAS TO BE INCREASED 10mm
FOR EACH 10m OF PIPE
EL DIAMETRO DEL COLECTOR DE
ESCAPE DEBE SER INCREMENTADO
10mm POR CADA 10m DE COLECTOR

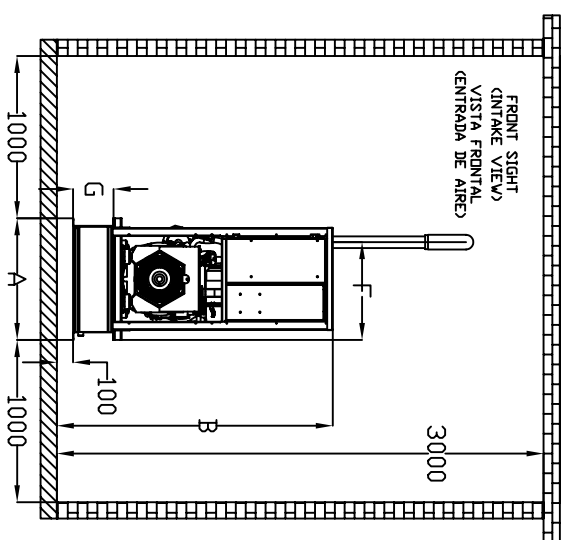

	GSL30D	GSL42D
A (mm)	750	750
B (mm)	1700	1700
B1 (mm)	1600	1600
C (mm)	1800	1800
C1 (mm)	1500	1500
D (mm)	540	540
E (mm)	---	---
F (mm)	---	---
G (mm)	250	250
H (mm)	45	45
I (mm)	500	500
J (mm)	520	520

COOLING AIR INTAKE
ENTRADA DE AIRE

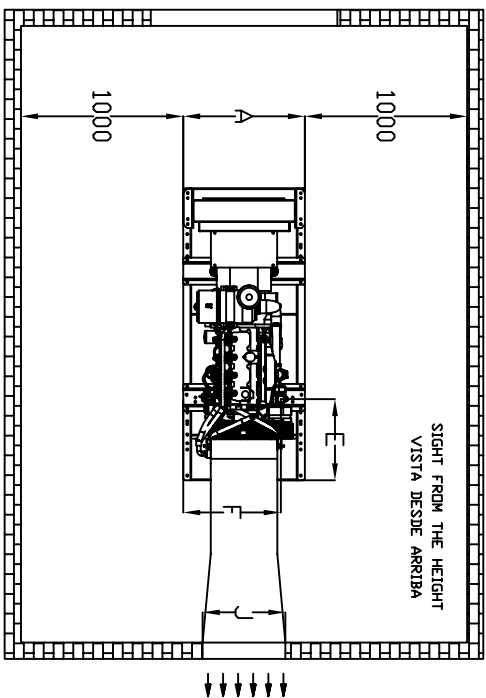

MODEL/ MODELO	AIR FLOW/CAUDALES DE AIRE (M ³ /H)		FUEL CONSUMPTION/ CONSUMO DE COMBUSTIBLE (L/H)	
	COMBUSTION	COOLING AIR	EXHAUST GASES	75% LOAD
GSL30D	117	2520	314	5.3
GSL42D	151	3318	432	7.1

MODEL/ MODELO	PRIME POWER POTENCIA	ENGINE MOTOR	ALTERNATOR ALTERNADOR	FUEL TANK (LIT) DEPOSITO DE COMBUSTIBLE	WEIGHT (KG) PESO (KG)
GSL30D	29	F4M2011	BC1184F	90	714
GSL42D	39.3	BF4M2011	BC1184J	90	761

NOTE: GENERATING SET MUST BE LOCATED WITH, AT LEAST, ONE METER FREE SPACE AROUND FOR MAINTENANCE WORK SURFACE OF COOLING AIR INTAKE LOUVERS MUST BE, AT LEAST, TWICE SURFACE OF COOLING AIR EXHAUST LOUVERS

NOTA: EL GENERADOR DEBE SITUARSE CON, AL MENOS, UN METRO LIBRE ALREDEDOR PARA TRABAJOS DE MANTENIMIENTO LA SUPERFICIE DE REJILLA DE REFRIGERACION DE ENTRADA DEBE SER, AL MENOS, DOS VECES LA SUPERFICIE DE LA REJILLA DE SALIDA DE AIRE

* IF IN DOUBT-ASK, DO NOT SCALE / EN CASO DE DUDA-PREGUNTAR, NO ESCALAR
* RECOMMENDED INSTALLATION DIMENSIONS FOR STANDARD CONFIGURATION /
DIMENSIONES DE INSTALACION RECOMENDADAS PARA CONFIGURACION ESTANDAR
* THE PRODUCER RESERVES THE RIGHT OF MODIFYING THE DIMENSIONS REPRESENTED IN THIS PLANE WITHOUT PRIOR NOTICE
EL FABRICANTE SE RESERVA EL DERECHO DE MODIFICAR LAS DIMENSIONES REPRESENTADAS EN ESTE PLANO SIN PREVIO AVISO

2004	DATE	NAME
Drawn		JGM
Checked		JUG
SCALE		

RECOMMENDED INSTALLATION DIMENSIONS
STANDARD GENSET

GSL30D-42D - 1.500 RPM

Replaced by:

PRAMAC POWER ENGINEERING

Nº PTCN 30D-42D_300